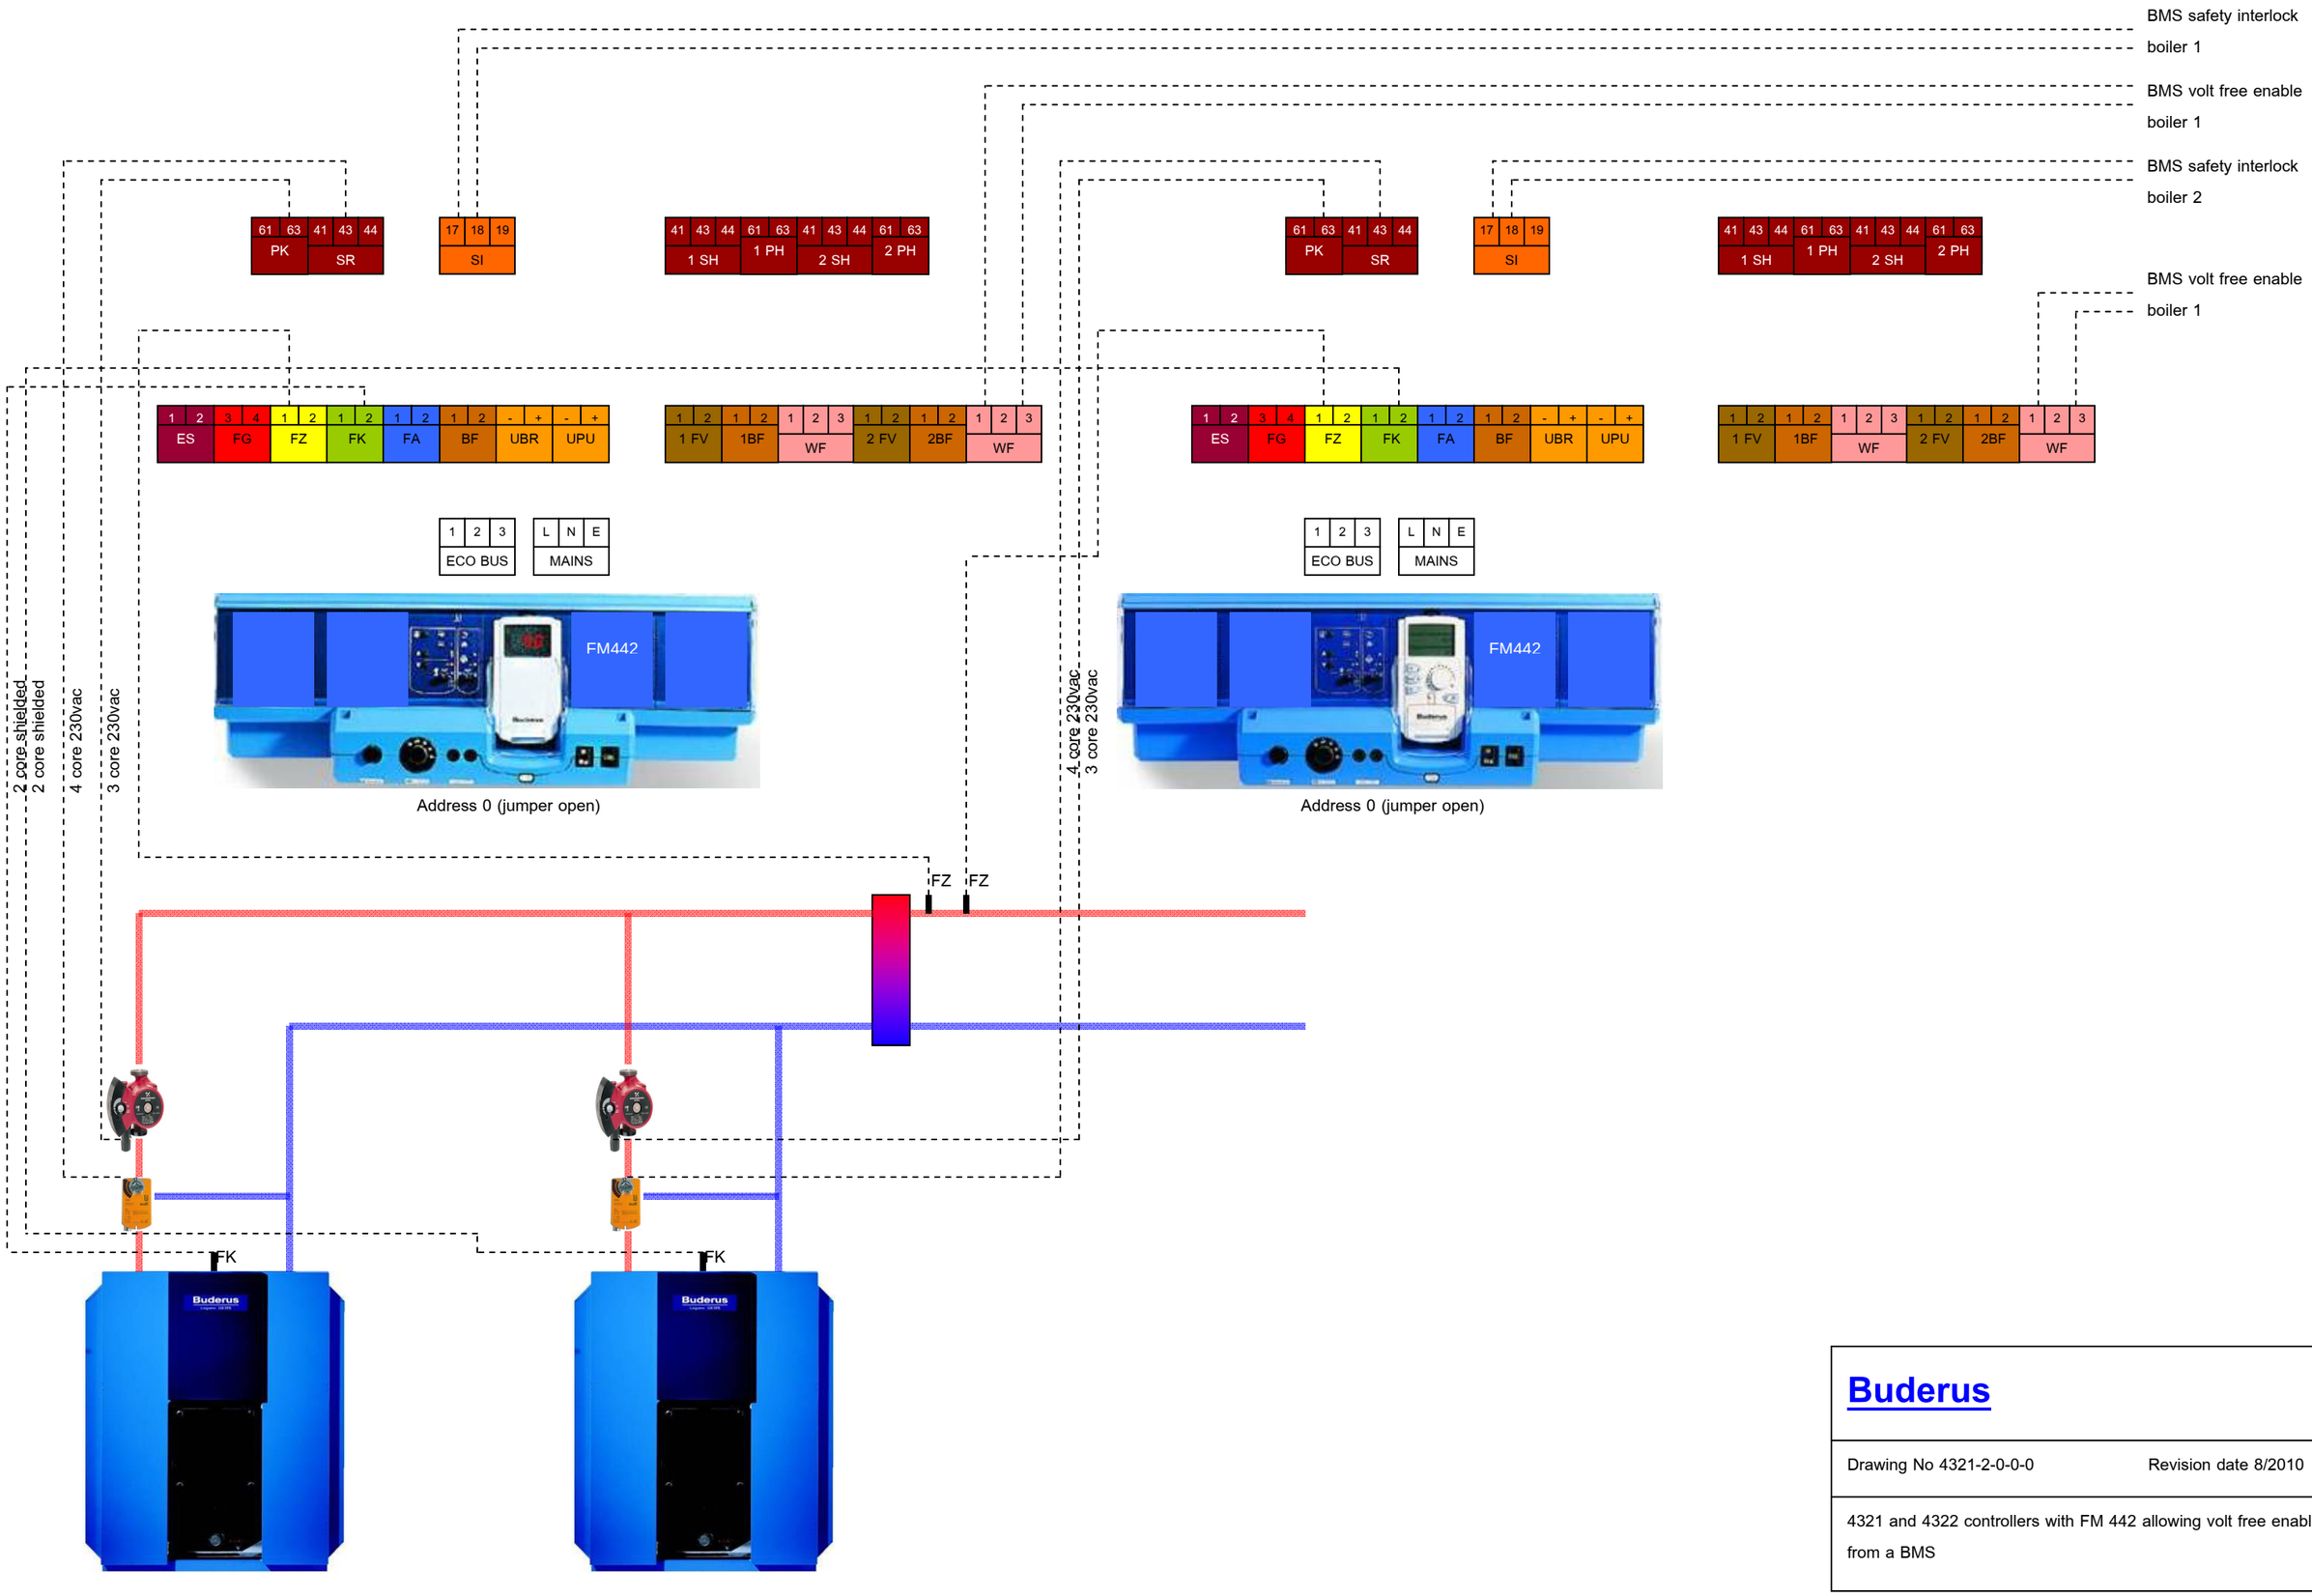

Buderus

Drawing No 4321-2-0-0-0 Revision date 8/2010

4321 and 4322 controllers with FM 442 allowing volt free enable from a BMS